


3/4" SCH. 40 PVC  
OR COPPER

2-1/2" SCH. 80 PVC  
CAP W/ 3/4" OUTLET  
OR EQUIVALENT.

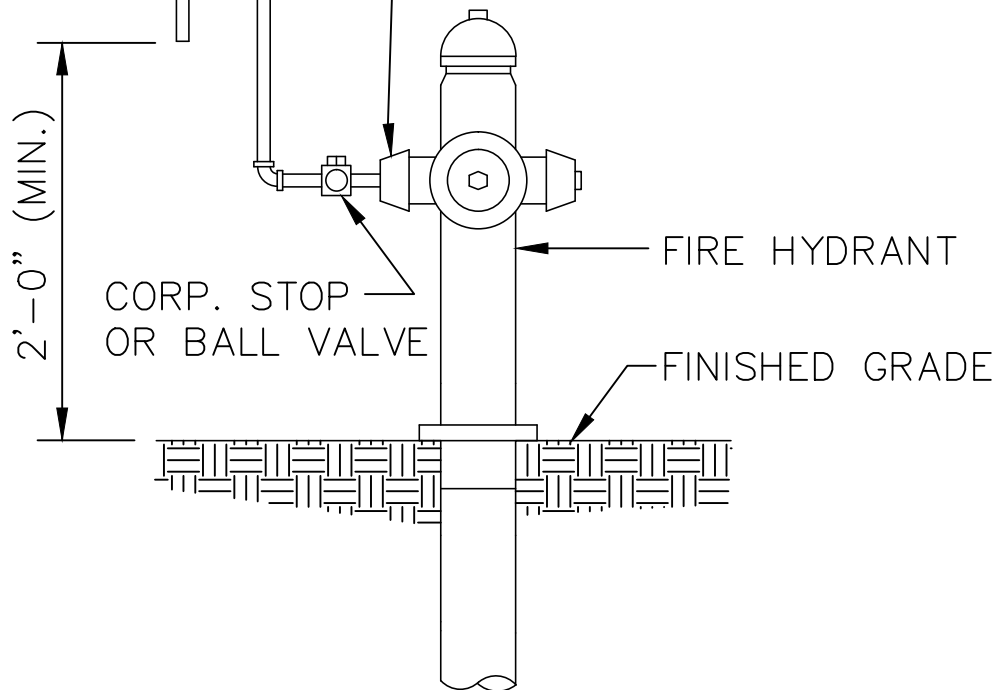

## SAMPLE POINT ( HYDRANT ) 2011

ALL D.I.P. TO BE PAINTED  
BLUE ON TOP HALF OF PIPE.

### ENGINEERING STANDARDS 2011

REVISIONS		ENGINEERING DEPARTMENT CITY OF POMPANO BEACH	<b>SAMPLE POINT (HYDRANT)</b>	
BY	DATE			
S.S.	APRIL2005		DATE: JUNE 1996	
			DWG. NO.	
		SCALE: N.T.S.	<b>101-1</b>	