


ADJUSTABLE PIPE SUPPORT PER 202-1
DETAIL (BY CONTRACTOR OR OWNER)

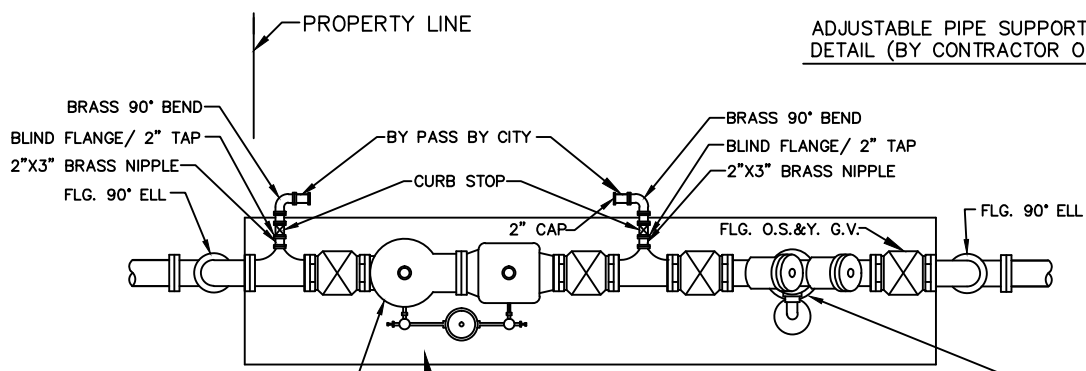


FIRE DOMESTIC SERVICE METER
INSTALLED BY CITY.
ALL WATER METERS ARE INSTALLED
PERPENDICULAR TO WATER MAIN.

2'-0" WIDE CONC. SLAB (3000 PSI) REINF.
W/6x6 # 10 WWM (LENGTH AS REQUIRED)
OR FIBER REINFORCED.
INSTALLED BY OWNER OR CONTRACTOR.

REDUCE PRESSURE BACKFLOW PREVENTER (PRIVATE WATER MAIN)
OR DOUBLE DETECTOR CHECK VALVE (FIRE MAIN) FURNISHED AND
INSTALLED BY OWNER/CONTRACTOR IN ACCORDANCE WITH CITY
RECOMMENDATIONS.

PLAN

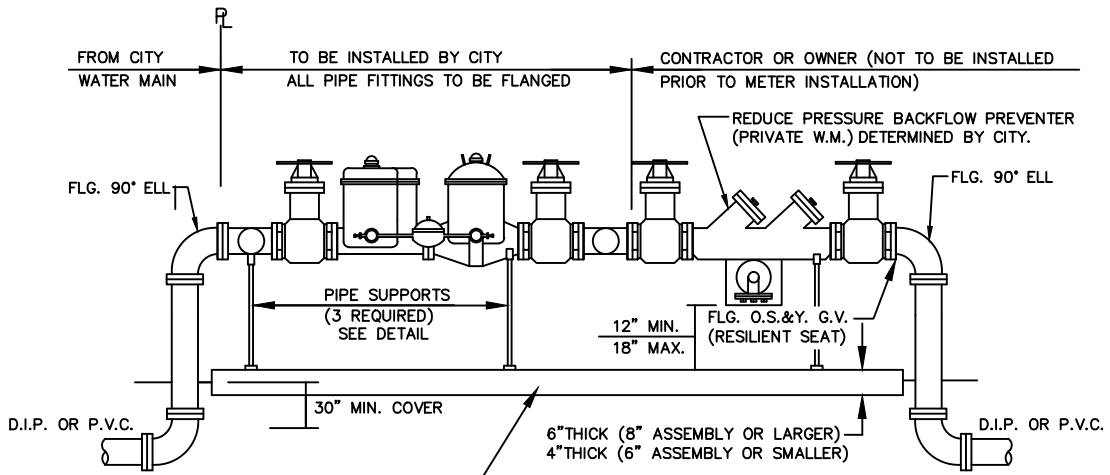

2'-0" WIDE CONC. SLAB (3000 PSI) REINF.
W/6x6 # 10 WWM (LENGTH AS REQUIRED)
OR FIBER REINFORCED.
INSTALLED BY OWNER OR CONTRACTOR.

ELEVATION

**MASTER METER AND BACKFLOW DEVICE DETAILS
FIRE AND DOMESTIC COMBINED SOURCE 2011**

USE MEGALUGS AT ALL PIPE JOINTS

PLEASE SEE METER INSTALL DIMENSION LIST ON STANDARD NO. 106-4

ENGINEERING STANDARDS 2011

REVISIONS		ENGINEERING DEPARTMENT CITY OF POMPANO BEACH	MASTER METER AND BACKFLOW DEVICE	DATE: JUNE 1996 DWG. NO. 106-2
BY	DATE			
S.S.	APRIL 2005			
T.W.	11-2007			
S.S.	03-2009			
S.S.	05-2011	SCALE: N.T.S.		