



ADJUSTABLE PIPE SUPPORT PER 202-1
DETAIL (BY CONTRACTOR OR OWNER)

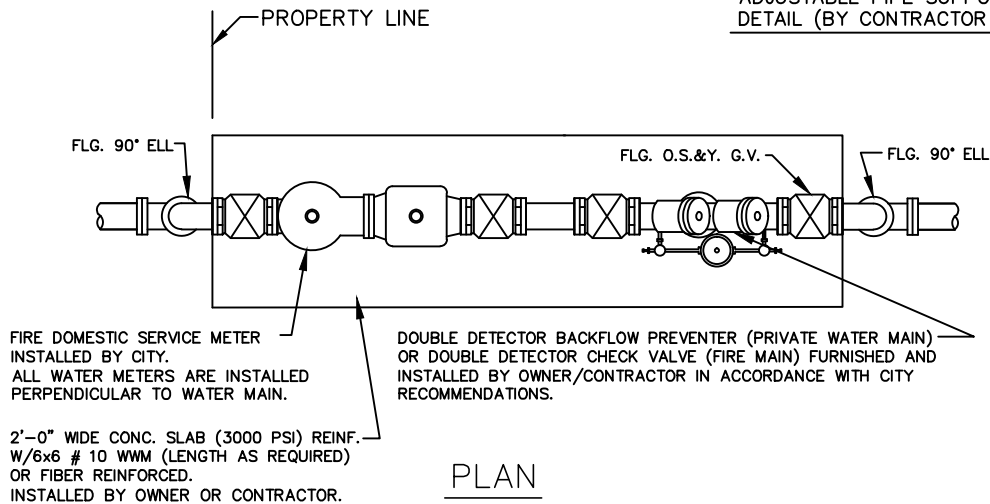

PLAN

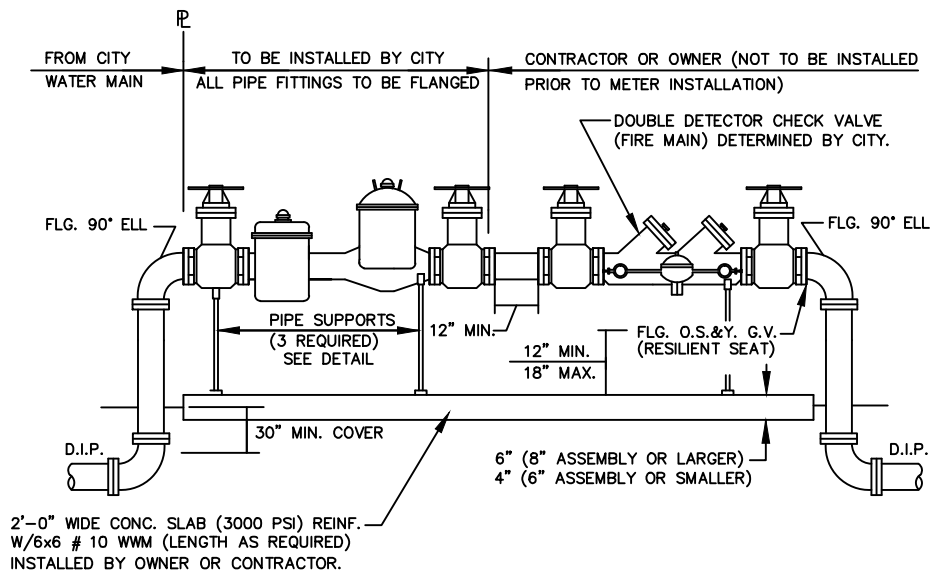

ELEVATION

FIRE ONLY METER AND BACKFLOW DEVICE DETAILS 2011

USE MEGALUGS AT ALL PIPE JOINTS

PLEASE SEE METER INSTALL DIMENSION LIST ON STANDARD NO. 106-4

ENGINEERING STANDARDS 2011

REVISIONS		ENGINEERING DEPARTMENT CITY OF POMPANO BEACH	FIRE ONLY METER AND BACKFLOW DEVICE
BY	DATE		
S.S.	APRIL 2005		
T.W.	11-2007		
S.S.	03-2009		
S.S.	05-2011	SCALE: N.T.S.	DATE: JUNE 1996 DWG. NO. 106-3