



ADJUSTABLE PIPE SUPPORT
DETAIL (BY CONTRACTOR)

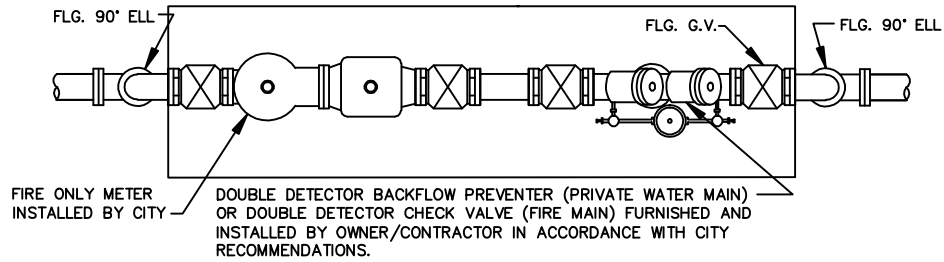

PLAN

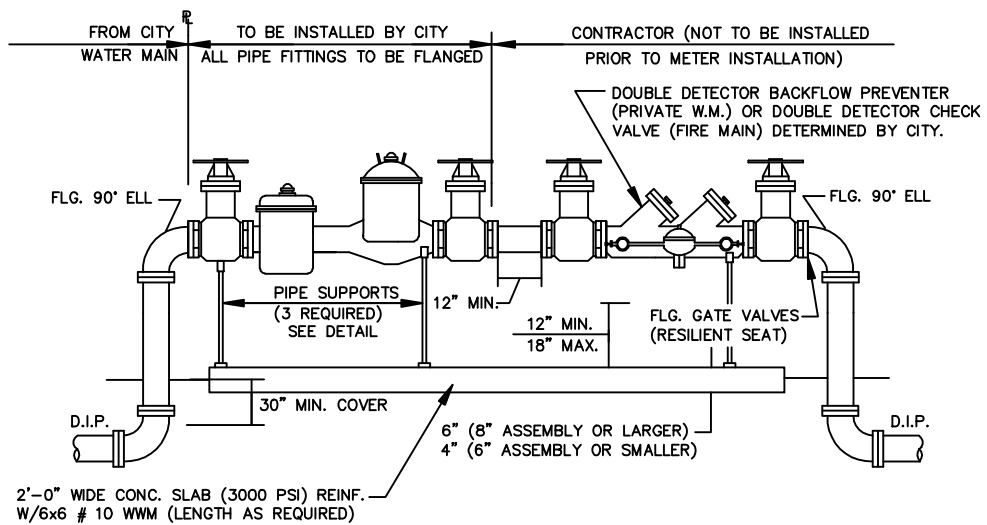

ELEVATION

FIRE ONLY METER AND BACKFLOW DEVICE DETAILS

USE MEGALUGS AT ALL PIPE JOINTS

PLEASE SEE METER INSTALL DIMENSION LIST ON STANDARD NO. 106-4

ENGINEERING STANDARDS

REVISIONS		ENGINEERING DEPARTMENT CITY OF POMPANO BEACH	FIRE ONLY METER AND BACKFLOW DEVICE	
BY	DATE			
S.S.	APRIL 2005		APPROVED BY:	DATE: JUNE 1996
T.W.	11-2007		CITY ENGINEER	DWG. NO. 106-3
SCALE: N.T.S.				