


PLAN

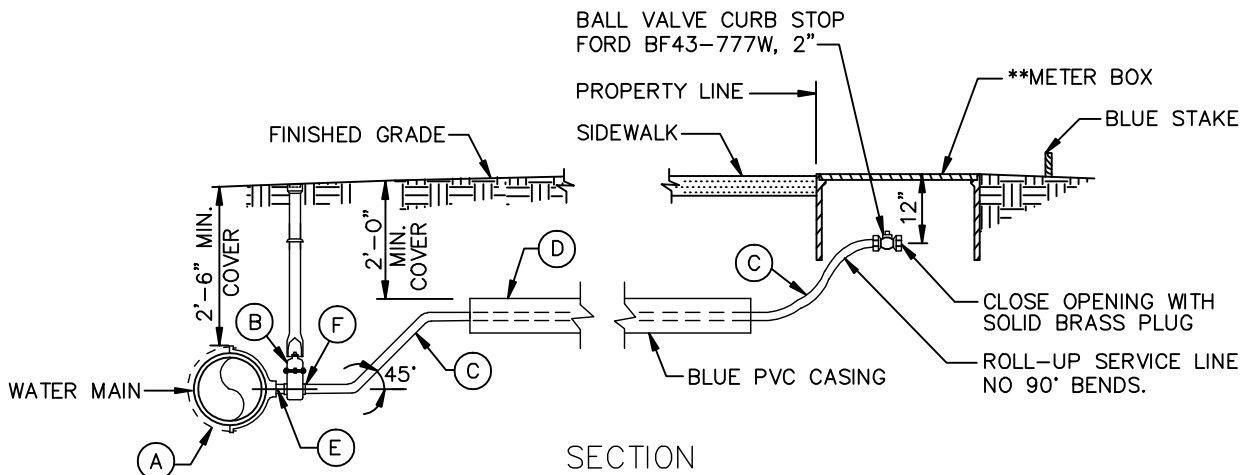

SECTION

- (A) 2" TAPPING SADDLE IRON PIPE
THREADED FORD FC-202 OR EQUAL.
- (B) 2" RESILIENT SEATED GATE VALVE
CLOW F61-03
MUELLER A-23-60-8
2" OPERATING NUT BOXED TO GRADE - C.I. BOX
- (C) 2" POLYETHYLENE BLUE
- (D) 2 1/2" SCH. 40
- (E) 2" X 3" BRASS NIPPLE
- (F) 2" MIP COUPLING

TYPICAL 2" WATER SERVICE

USE MEGALUGS AT ALL PIPE JOINTS

ALL D.I.P. TO BE PAINTED
BLUE ON TOP HALF OF PIPE.

ENGINEERING STANDARDS

REVISIONS		ENGINEERING DEPARTMENT CITY OF POMPANO BEACH	TYPICAL WATER SERVICE	
BY	DATE		APPROVED BY: _____	
S.S.	5/15/00			
K.J.B.	08.23.04		DWG. NO.	
S.S.	APRIL 2005		107-2	
T.W.	11-2007	CITY ENGINEER		
SCALE: N.T.S.				