


PLAN

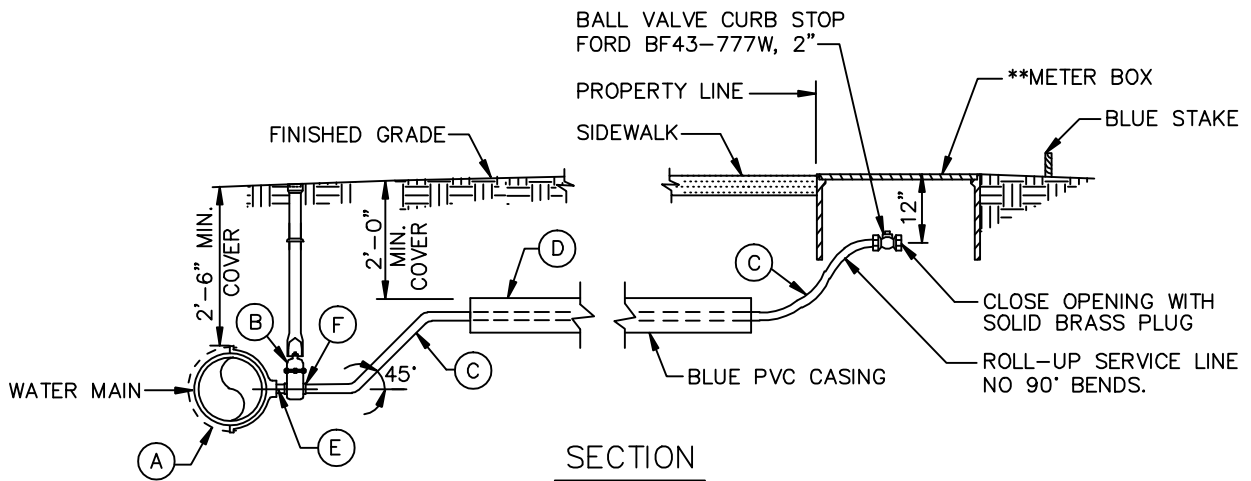

SECTION

- (A) 2" TAPPING SADDLE IRON PIPE
THREADED FORD FC-202 OR EQUAL.
- (B) 2" RESILIENT SEATED GATE VALVE
CLOW F61-03
MUELLER A-23-60-8
2" OPERATING NUT BOXED TO GRADE - C.I. BOX
- (C) 2" POLYETHYLENE BLUE
- (D) 2 1/2" SCH. 40
- (E) 2" X 3" BRASS NIPPLE
- (F) 2" MIP COUPLING C-84-77 - PACK JOINT - CTS

TYPICAL 2" WATER SERVICE

USE MEGALUGS AT ALL PIPE JOINTS

ALL D.I.P. TO BE PAINTED
BLUE ON TOP HALF OF PIPE.

ENGINEERING STANDARDS

REVISIONS		ENGINEERING DEPARTMENT CITY OF POMPANO BEACH	TYPICAL WATER SERVICE		
BY	DATE		SCALE: N.T.S.	APPROVED BY:	DATE: APRIL 2000
K.J.B.	08.23.04	CITY ENGINEER		DWG. NO.	
S.S.	APRIL 2005			107-2	
T.W.	11-2007				
T.W.	08-2009				