


PLAN

\*\* ALL WATER METERS ARE INSTALLED PERPENDICULAR TO WATER MAIN.

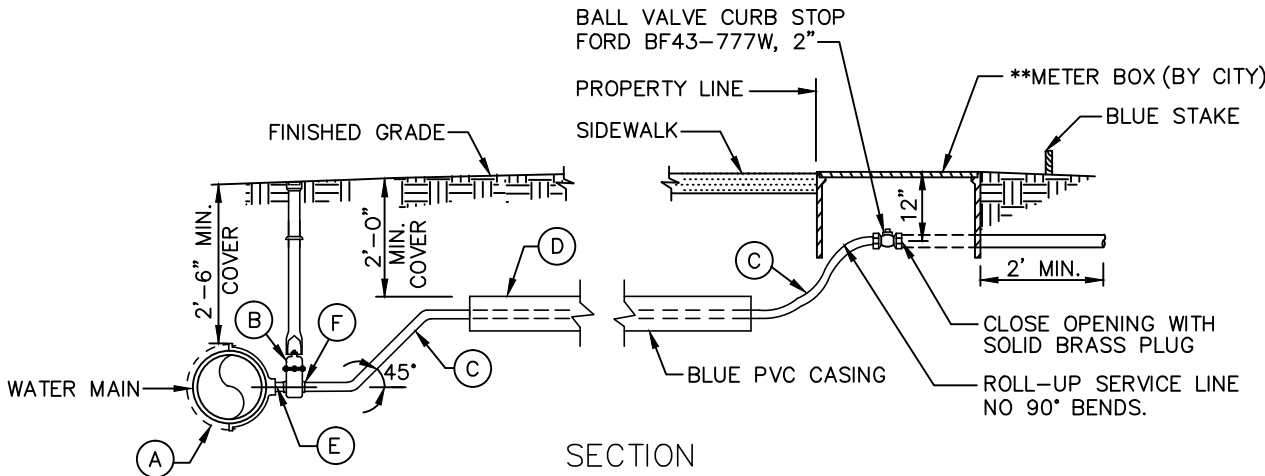

SECTION

- (A) 2" TAPPING SADDLE IRON PIPE  
THREADED FORD FC-202 OR EQUAL.
- (B) 2" RESILIENT SEATED GATE VALVE  
CLOW F61-03  
MUELLER A-23-60-8  
2" OPERATING NUT BOXED TO GRADE - C.I. BOX
- (C) 2" POLYETHYLENE BLUE
- (D) 2 1/2" SCH. 40
- (E) 2" X 3" BRASS NIPPLE
- (F) 2" MIP COUPLING C-84-77 - PACK JOINT - CTS

**TYPICAL 2" WATER SERVICE 2011**

**ENGINEERING STANDARDS - 2011**

REVISIONS		ENGINEERING DEPARTMENT CITY OF POMPANO BEACH	TYPICAL WATER SERVICE	
BY	DATE			
S.S.	04-2005		DATE: APRIL 2000 DWG. NO.	
T.W.	11-2007			
T.W.	08-2009			
S.S.	05-2011	SCALE: N.T.S.	107-2	